


FUSED DISCONNECT FOR MAIN POWER SUPPLY, WIRED TO ELEV. CONTROLLER BY ELECTRICAL CONTRACTOR

FUSED DISCONNECT FOR CAR-LIGHTING & CONTROLLER CIRCUIT, WIRED TO ELEVATOR CONTROLLER BY ELECTRICAL CONTRACTOR (BELOW, TYP.)

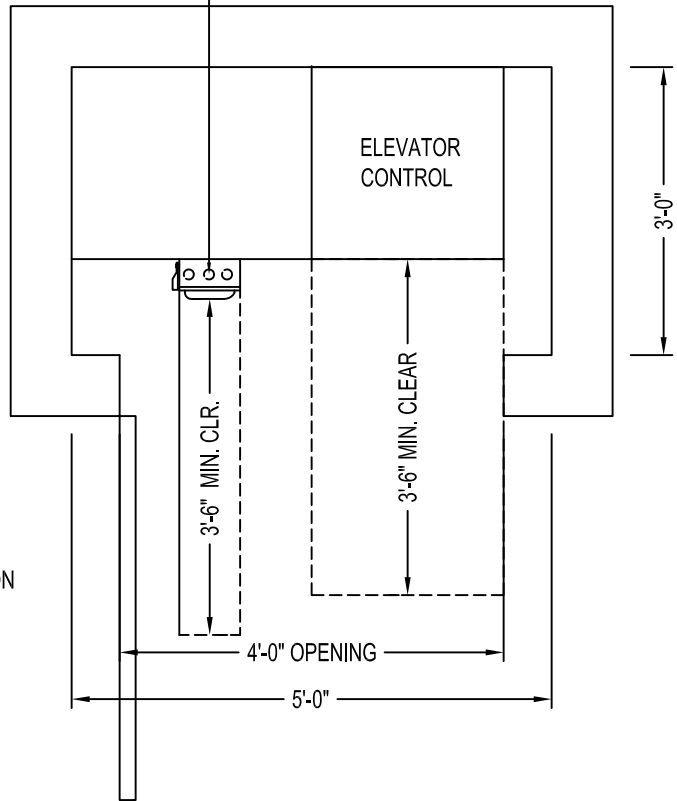

- NOTE: CONTROL ROOM MUST:
- HAVE 7'-0" CLEAR HEADROOM
 - BE VENTILATED-NATURALLY OR MECHANICALLY
 - HAVE SELF-CLOSING AND SELF-LOCKING DOOR
 - BE ACCESSIBLE TO AUTHORIZED PERSONNEL ONLY
 - CONTAIN EQUIPMENT REQUIRED FOR THE OPERATION OF THE ELEVATOR ONLY

MINIMUM MRL CONTROL ROOM



DRAWING NAME	
MRL - MINIMUM MACH ROOM	
DRAWN BY NB	DATE 06/05/2015
CHECKED BY	
REV. NO. 0	Drawing No. -