


FUSED DISCONNECT FOR MAIN POWER
SUPPLY, WIRED TO ELEV. CONTROLLER BY
ELECTRICAL CONTRACTOR

FUSED DISCONNECT FOR CAR-LIGHTING &
CONTROLLER CIRCUIT, WIRED TO ELEVATOR CONTROLLER
BY ELECTRICAL CONTRACTOR (BELOW, TYP.)

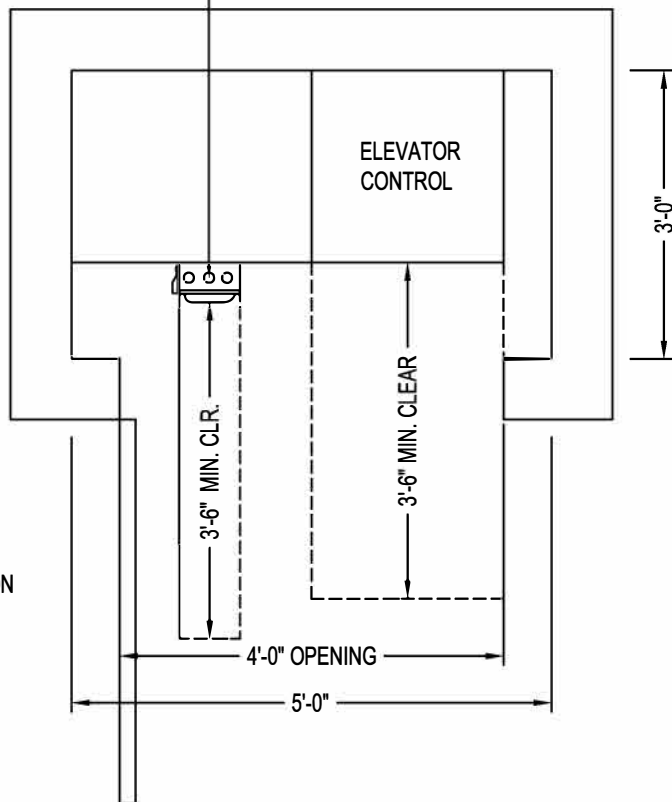

NOTE: CONTROL ROOM MUST:

- HAVE 7'-0" CLEAR HEADROOM
- BE VENTILATED-NATURALLY OR MECHANICALLY
- HAVE SELF-CLOSING AND SELF-LOCKING DOOR
- BE ACCESSIBLE TO AUTHORIZED PERSONNEL ONLY
- CONTAIN EQUIPMENT REQUIRED FOR THE OPERATION OF THE ELEVATOR ONLY

MINIMUM MRL CONTROL ROOM



DRAWING NAME	
MRL - MINIMUM CONTROL ROOM	
DRAWN BY NB	DATE 06/05/2015
CHECKED BY	
REV. NO. 0	Drawing No.